






TS 03 DĚTSKÁ KLINIKA (DTS 91555)



22-AXKVVCEY 1X240/25

22-AXKVVCEY 1X240/25

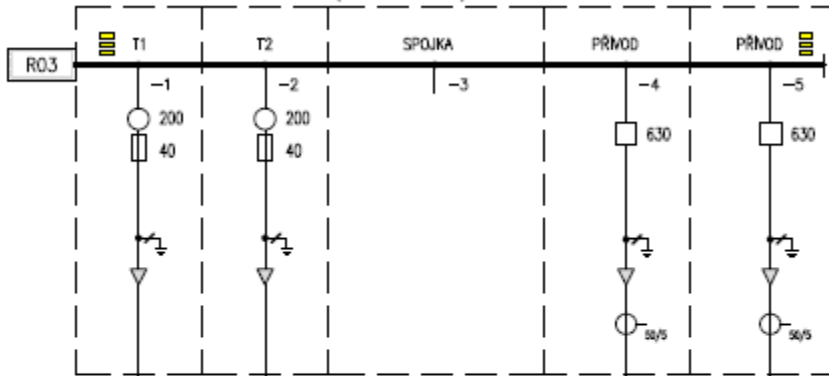

TR3

TR4

630 kVA


22/0,4 kV

0,71

Δ/Y

Δ/Y

ROZVADEČ NN - RH

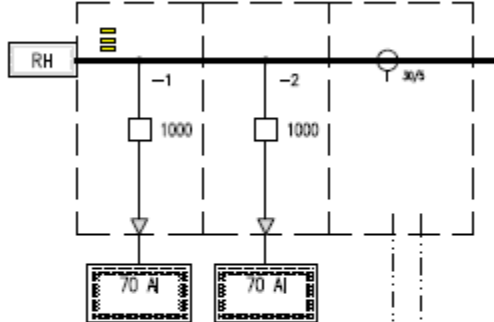

DTS 91555
DĚTSKÁ KLINIKA

R-VN	
$P_t = 1260 \text{ kW}$	$\beta = 0,46$
$P_p = 580 \text{ kW}$	$\cos \varphi = 0,95$
$I = 50 \text{ A}$	$k'' =$
$I_r =$	$I_{p3} =$
$I_c =$	$I_{ke} =$

OBCHODNÍ MĚŘENÍ
USM